

THESE PLANS ARE THE PROPERTY OF MRP DESIGN GROUP, INC. AND ARE SUBJECT TO FEDERAL COPYRIGHT LAWS. ANY USE OF SAME WITHOUT THE EXPRESS WRITTEN PERMISSION OF MRP DESIGN GROUP, INC. IS STRICTLY PROHIBITED.

PROJ: BAR-B-CUTIE MISSION, TX										PANEL: MDP		DATED: 10/11/19		REVS: 00		X
208	VOLT-LL		22	K-AIC RATING						ENCLOSURE TYPE:		NEMA 1				
120	VOLT- LN		3	PHASE		4	W			BRANCH OCP TYPE:		M C BKRS				
400	BUSS AMPS		400	MAIN OCP						GENERAL NOTES:		SURFACE MTD, NOTE 1				
R	N	DESCRIPTION	LT	WVA	AMP	P	#	P	#	AMP	P	WVA	LT	DESCRIPTION	N	R
2	RTU-1	---	C	3288	40	-	1	A	2	150	-	11000	M	PANEL A	3	
	---	---	C	3288	-	/	3	B	4	-	/	10000	A	---		
	---	---	C	3288	-	/	3	C	6	-	/	11000	R	---		
2	RTU-2	---	C	3288	40	-	7	A	8	150	-	12000	A	PANEL B		
	---	---	C	3288	-	/	9	B	10	-	/	14000	A	---		
	---	---	C	3288	-	/	11	C	12	-	/	14000	A	---		
2	RTU-3	---	C	3288	40	-	13	A	14	20	-	1088	C	MUA-1 (COND. #1)	2	
	---	---	C	3288	-	/	15	B	16	-	/	1088	C	---		
	---	---	C	3288	-	/	17	C	18	-	/	1088	C	---		
2	RTU-4	---	C	3288	40	-	19	A	20	20	-	1088	C	MUA-1 (COND. #2)	2	
	---	---	C	3288	-	/	21	B	22	-	/	1088	C	---		
	---	---	C	3288	-	/	23	C	24	-	/	1088	C	---		
	SPACE						25	A	26					SPACE		
	SPACE						27	B	28					SPACE		
	SPACE						29	C	30					SPACE		
	SPACE						31	A	32					SPACE		
	SPACE						33	B	34					SPACE		
	SPACE						35	C	36					SPACE		
	SPACE						37	A	38					SPACE		
	SPACE						39	B	40					SPACE		
	SPACE						41	C	42					SPACE		
NT# 1. PROVIDE WISOLATED GROUND. 3. PROVIDE ISOLATED GROUND IN CIRCUIT. 2. PROVIDE HACR TYPE CIRCUIT BREAKER																
PHS-A		38	KVA	319	32%	FACTORED END-USE		92.6	KVA	257	A					
PHS-B		39	KVA	328	33%	PASS THRU LOAD		0.0	KVA	0	A					
PHS-C		40	KVA	336	34%	SPARE		10%	9.3	KVA	26	A				
SUM		118	KVA	327	AMPS	GRAND TOTALS		101.8		283	A					

PROJ: BAR-B-CUTIE-MISSION, TX					PANEL: A		DATED: 10/11/19		REVS: 00		X						
208	VOLT-LL	10	K-AIC RATING					ENCLOSURE TYPE	NEMA 1								
120	VOLT- LN	3	PHASE	4	W			BRANCH OCP TYPE	M C BKRS								
225	BUSS AMPS	MLO	MAIN OCP					GENERAL NOTES:	SURFACE MTD, NOTE 2								
R	N	DESCRIPTION	LT	WIVA	AMP	P	#	P	#	AMP	P	WIVA	LT	DESCRIPTION	N	R	
		LTG-100-115	L	2422	20 / 1	A	2	20 / 1		1000	L	LTG-FRONT SIGN					
		LTG-CONTRACTOR LOG#1	L	500	20 / 1	B	4	20 / 1		1000	L	LTG-SIDE SIGN					
		LTG-101,102,106	L	840	20 / 1	C	6	20 / 1		1000	R	REC-TV'S					
		LTG-WVC	L	120	20 / 1	A	8	20 / 1		800	R	REC-TV'S					
		HOOD CONTROL	M	500	20 / 1	B	10	20 / 1		1440	A	REC-NITRO OKR, #52					
		LTG-HOOD	L	220	20 / 1	C	12	20 / 1		1440	A	REC-NITRO OKR, #52					
		REC-TBB	R	500	20 / 1	A	14	20 / 1		1440	A	REC-NITRO OKR, #52					
		MUA-1 CONTROL	M	500	20 / 1	B	16	20 / 1		1440	A	REC-NITRO OKR, #52					
		FIRE SUPPRESSION SYS	M	500	20 / 1	C	18	20 / 1		1728	A	REC-HEAT LAMPS, #66					
		REC-102	R	1080	20 / 1	A	20	20 / 1		200	M	SMOKE DETECTORS					
		REC-101,102,106	R	900	20 / 1	B	22	20 / 1		500	M	HW GTLS					
		REC-100,103,106,107	R	900	20 / 1	C	24	20 / 1		720	R	REC-RTUS, ROOF					
		REC-113,114,115	R	1080	20 / 1	A	26	20 / 1		480	R	REC-POS/IFTR, #63			1		
		REC-106,109,110,116	R	720	20 / 1	B	28	20 / 1		480	R	REC-POS/IFTR, #63			1		
		HAND DRYER-111	R	1800	20 / 1	C	30	20 / 1		480	R	REC-POS/IFTR, #63			1		
		HAND DRYER-109	R	1800	20 / 1	A	32	20 / 1		480	R	REC-COMPUTER, #114			1		
		ACF-1	H	612	20 / 1	B	34	20 / 1		864	A	REC-BAG-IN-BOX, #24					
		TEF-1	H	360	20 / 1	C	36	20 / 1		900	R	REC-107,108					
		EF (SMOKER)	H	1200	20 / 1	A	38	20 / 1				SPARE					
		REC-R REFRIG., #56	A	648	20 / 1	B	40	20 / 1				SPARE					
		REC-TV'S	R	800	20 / 1	C	42	20 / 1				SPARE					
NT# 1. PROVIDE ISOLATED GROUND IN CIRCUIT. 2. PROVIDE WISOLATED GROUND.																	
PHS-A		11	KVA	95	34%	FACTORED END-USE		28.8	KVA	80	A	BOX A					
PHS-B		10	KVA	84	30%	PASS THRU LOAD		0.0	KVA	0	A	0 A					
PHS-C		12	KVA	97	35%	SPARE		10%	2.9	KVA	8	A	8 A				
SUM		33	KVA	92	AMPS	GRAND TOTALS		31.7			88	A					

PROJ: BAR-B-CUTIE MISSION, TX										PANEL: B		DATED: 10/11/19		REVS: 00		X	
208	VOLT-LL	10	K-AIC RATING							ENCLOSURE TYPE	NEMA 1						
120	VOLT- LN	3	PHASE	4	W					BRANCH OCP TYPE	M/C BKRS						
225	BUSS AMPS	MLO	MAIN OCP							GENERAL NOTES:	SURFACE MTD						
R	N	DESCRIPTION	LT	WIVA	AMP	P	#	P	#	AMP	P	WIVA	LT	DESCRIPTION	N	R	
		REC-DRINK DISP., #76	A	960	20	/	1	A	2	20	/	1	600	A	REC-WT FRZR, #33	2	
		REC-DRINK DISP., #76	A	960	20	/	3	B	4	-	-	-	-		SHUNT TRIP FOR OKT#2		
		REC-DRINK DISP., #76	A	960	20	/	5	C	6	20	/	1	1320	A	REC-ICE MACH., #21	1	
		REC-DRINK DISP., #76	A	960	20	/	7	A	8	15	-	-	528	H	MUA-1, #35		
		REC-TEA BRWR, #74	A	1704	20	/	9	B	10	-	-	-	528	H	---		
1		REC-ICE MAKER, #65	A	1320	20	/	11	C	12	-	/	3	528	H	---		
1		REC-ICE MAKER, #65	A	1320	20	/	13	A	14	20	-	-	1560	C	WVC CONDENSER, #13	1	
1		REC-ICE MAKER, #65	A	1320	20	/	15	B	16	-	-	2	1560	C	---		
1		REC-ICE MAKER, #65	A	1320	20	/	17	C	18	20	-	-	1498	A	REC-MICROWAVE, #54		
		KEF-1, #35	H	456	15	-	19	A	20	-	-	2	1498	A	---		
		---	H	456	-	-	21	B	22	20	-	-	1300	A	REC-TOASTER, #48		
		---	H	456	-	1	23	C	24	-	-	2	1300	A	---		
		SHUNT TRIP FOR OKT#27			-	-	25	A	26	20	-	1	1704	A	REC-TEA BRWR, #74		
2		REC-RANGE, #40	A	744	20	/	27	B	28	20	-	1	1704	A	REC-TEA BRWR, #74		
1		REC-OPEN MERCH, #64	A	1320	20	/	29	C	30	20	-	1	1704	A	REC-TEA BRWR, #74		
1		REC-SAND/SLD, #46	A	696	20	/	31	A	32	20	-	1	216	C	WVC EVAP COIL, #13	1	
1		REC-UC FRZR, #73	A	240	20	/	33	B	34	20	-	1	1920	A	REC-HEATED CAB, #57	2	
1		REC-UC REFRIG, #61	A	240	20	/	35	C	36	-	-	1	1920	A	SHUNT TRIP FOR OKT #34		
		SPARE			20	/	37	A	38	20	-	1	1920	A	REC-HEATED CAB, #57		
		SPARE			20	/	39	B	40	20	-	1	1920	A	REC-HEATED CAB, #57		
		SPARE			20	/	41	C	42	20	-	1	1920	A	REC-HEATED CAB, #57		
NT# 1. PROVIDE HACR TYPE CIRCUIT BREAKER 2. PROVIDE CIRCUIT BREAKER W/SHUNT TRIP UPON FIRE SUPPRESSION SYSTEM ACTIVATION.																	
PHS-A		12	KVA	103	31%	FACTORED END-USE		29.5	KVA	82	A						
PHS-B		14	KVA	120	35%	PASS THRU LOAD		0.0	KVA	0	A						
PHS-C		14	KVA	116	34%	SPARE		10%	2.9	KVA	8	A					
SUM		41	KVA	113	AMPS	GRAND TOTALS		32.4		90	A						


MECHANICAL EQUIPMENT CONNECTION SCHEDULE

EQUIPMENT	CIRCUIT DESIGNATION	FEEDER	DISCONNECT	FLA/KW	NOTES
RTU-1	MDP-1,3,5	3#8, #10(G), 3/4"C.	60/3/3R/40A	27.4 MCA	1,2
RTU-2	MDP-7,9,11	3#8, #10(G), 3/4"C.	60/3/3R/40A	27.4 MCA	1,2
RTU-3	MDP-13,15,17	3#8, #10(G), 3/4"C.	60/3/3R/40A	27.4 MCA	1,2
RTU-4	MDP-19,21,23	3#8, #10(G), 3/4"C.	60/3/3R/40A	27.4 MCA	1,2
KEF-1	NOTE 4	NOTE 4	INCLUDED	1 HP	1,4
MUA-1 FAN	NOTE 4	NOTE 4	30/3/3R/15A	1 1/2 HP	1,4
MUA-1 COND. #1	MDP-14,16,18	3#12, #12(G), 3/4"C.	30/3/3R/20A	11.2 MCA	1,4
MUA-1 COND. #2	MDP-20,22,24	3#12, #12(G), 3/4"C.	30/3/3R/20A	11.2 MCA	1,4
ACF-1	A-33	2#12, #12(G), 3/4"C.	MOTOR STARTER	5.1 FLA	1
TEF-1	A-35	2#12, #12(G), 3/4"C.	MOTOR STARTER	4.4 FLA	1,3

NOTES

- PROVIDE OVERCURRENT PROTECTION AND BRANCH CIRCUITS PER UL LISTED REQUIREMENTS FOR EQUIPMENT SERVED. REFER TO MANUFACTURER DATA AND EQUIPMENT CUT-SHEETS FOR ROUGHIN LOCATIONS OF ELECTRICAL CONNECTIONS AND INTERCONNECTIONS FOR ALL EQUIPMENT. COORDINATE EXACT NAMEPLATE DATA OF EQUIPMENT BEING INSTALLED WITH MECHANICAL CONTRACTOR.
- DUCT SMOKE DETECTORS SHALL BE CONNECTED BY FIRE ALARM CONTRACTOR. EC SHALL PROVIDE AND INSTALL REMOTE ANNUNCIATORS VISIBLE IN THE CEILING BELOW FOR THE SMOKE DUCT DET


THESE PLANS ARE THE PROPERTY OF MRP DESIGN GROUP, INC. AND ARE SUBJECT TO FEDERAL COPYRIGHT LAWS. ANY USE OF SAME WITHOUT THE EXPRESS WRITTEN PERMISSION OF MRP DESIGN GROUP, INC. IS STRICTLY PROHIBITED.

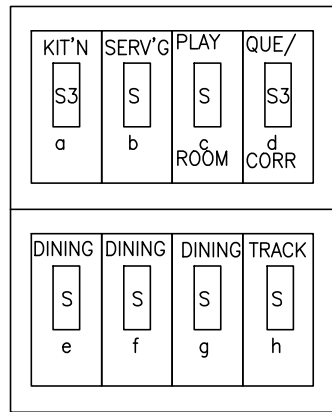

NOTES:
1. SWITCHES SHALL BE INSTALLED BETWEEN STUDS. MAKE (2) ROWS IF NECESSARY. DO NOT CUT STUDS TO ACCOMMODATE A SINGLE ROW OF SWITCHES.

2 SWITCH SWITCHBANK DETAIL

E100 NTS

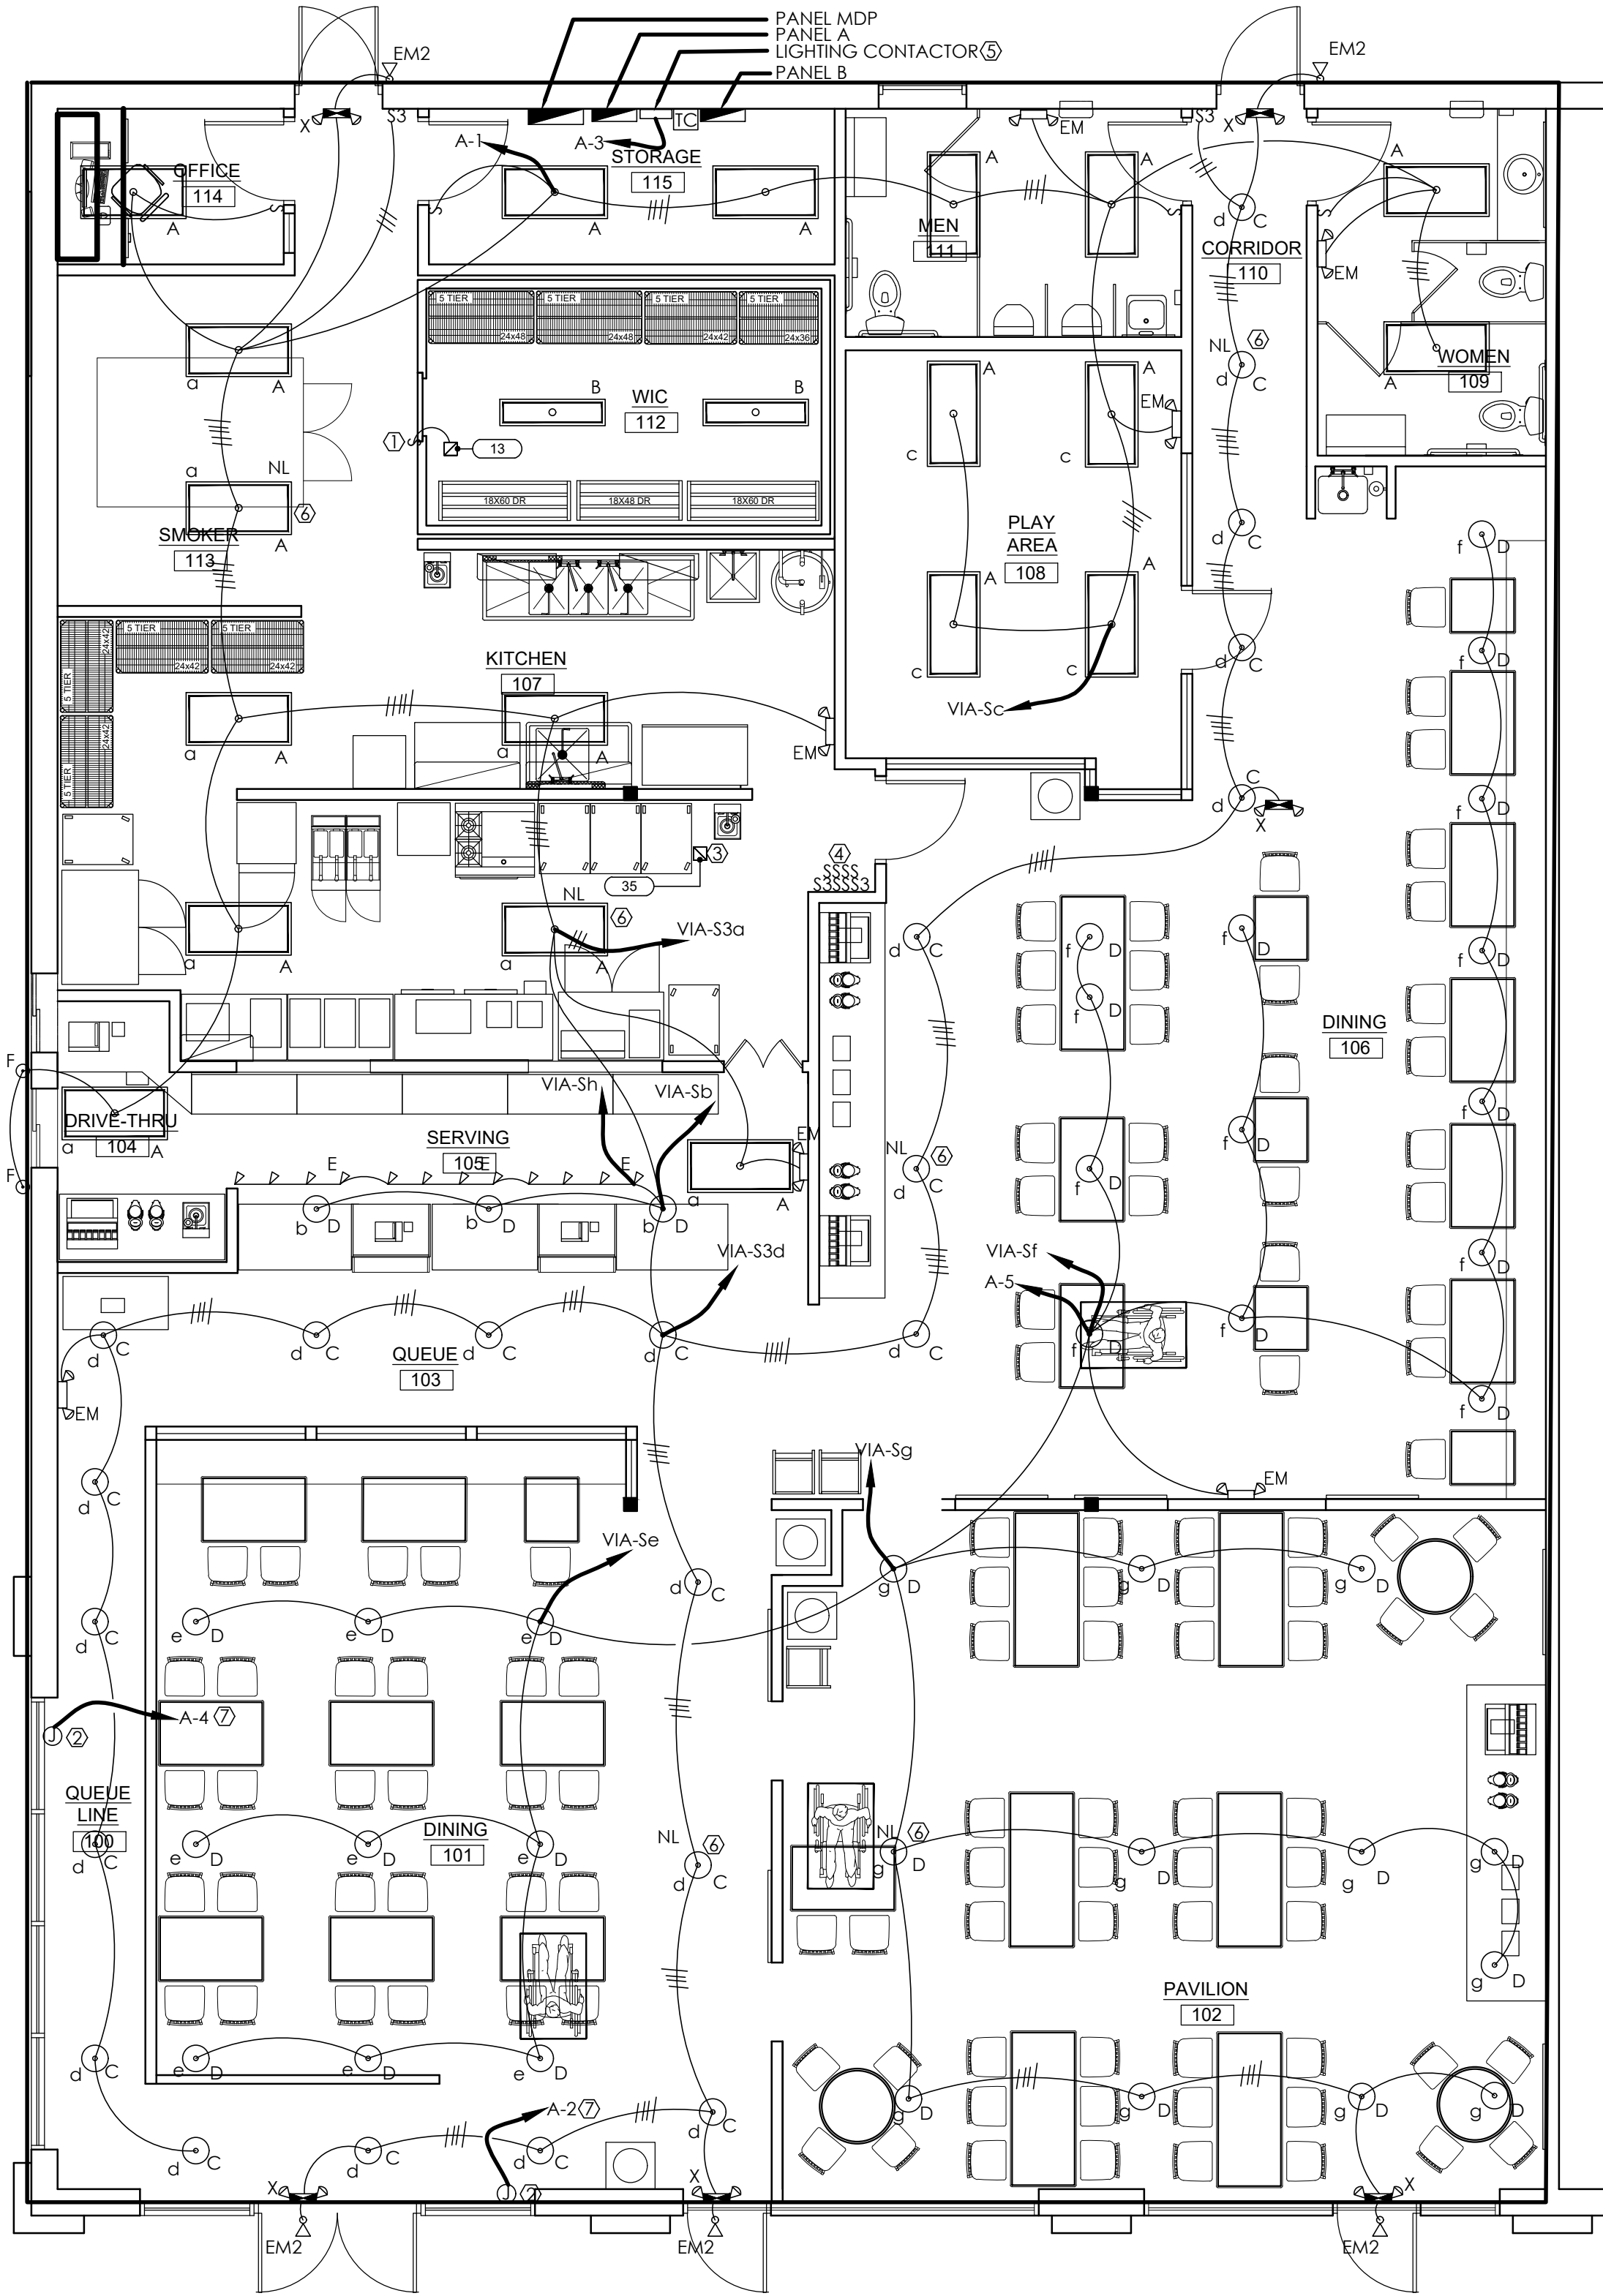

1 LIGHTING PLAN

E100 3/16"=1'-0"

LIGHTING FIXTURE SCHEDULE 2

MK	MTG.	MANUFACTURER	CATALOG No.	LAMPS		REMARKS	WATTS
				No.	TYPE		
A	REC	METALUX	24FR-LD4-40-UNV-L835-CD1-U	1	36W LED	2X4 LED TROFFER W/ACRLIC LENS	36
B	SURF	-	FURNISHED W/COOLER	1	LED	4', LED VAPORPROOF	35
C	PEND	MILLENNIUM LTG	RDBLED24-GA	1	24W LED	PENDANT LED, MT @ 7'-6"AFF	24
D	PEND	MILLENNIUM LTG	RLED24-GA	1	24W LED	PENDANT LED, MT @ 7'-6"AFF	24
E	SURF	JUNO LIGHTING	R4-BL W/R38-BL W/T691BL	1	13W LED	TRACK W/TRACK LIGHT	13
F	WALL	MILLENNIUM LTG	R2RRWS12LED24 W/RGN13	1	24W LED	WALL MTD LED	24
X	WALL	EXIT	VLED-U-BL-EL90-R	2	3.5W LED	COMBINATION EXIT/EMERGENCY LIGHT	-
EM	WALL	EXIT	LED90-BL	2	3.5W LED	EMERGENCY LIGHT, MOUNT @ 108" AFF	-
EM2	WALL	EXIT	1RL1-WP-GR	1	3.5W LED	REMOTE LED EMERGENCY EGRESS LIGHT	-

GENERAL NOTES:
1. ALL FIXTURES SHALL BE PROVIDED WITH LAMPS.
2. PROVIDE FIXTURE MANUFACTURER LISTED, OR EQUAL IN QUALITY, CERTIFICATION AND PERFORMANCE.

- 1 FIXTURES IN KITCHEN AREA SHALL BE PROVIDED WITH GASKETED LENS OR SHATTERPROOF LAMPS.
- 2 COORDINATE FIXTURE MOUNTING HEIGHT AND LOCATION REQUIREMENTS WITH ARCHITECTURAL DESIGN DRAWINGS/DETAILS/ELEVATIONS PRIOR TO ROUGH-IN.
- 3 COORDINATE THIS FIXTURE SELECTION AND MOUNTING HEIGHT WITH OWNER.

GENERAL NOTES:

- A. HOMERUNS MAY BE COMBINED AS ALLOWED BY THE NATIONAL ELECT. CODE ALL CONDUIT SHALL BE SIZED PER THE 2017 NEC.
- B. EXIT/EMERGENCY LIGHT FIXTURES SHALL BE CONNECTED AHEAD OF ROOM/AREA SWITCH, PER NEC ARTICLE 700-12 (f).
- C. COORDINATE WITH ARCHITECTURAL RCP AND ELEVATIONS FOR EXACT LOCATIONS AND MOUNTING HEIGHTS OF LIGHT FIXTURES, PRIOR TO ROUGH-IN.
- D. FOR LEGEND, SEE E000.

LIGHTING PLAN KEY NOTES:


- 1 PROVIDE RACEWAYS, WIRING, AND J-BOX FOR WIC COOLER UNITS. INSTALL COOLER LIGHTS AND CONNECT TO SWITCH. PROVIDE SEALS AS REQUIRED.
- 2 VERIFY THE EXACT LOCATION OF SIGN, AND MOUNT JUNCTION BOX ABOVE SOFFIT. ELECTRICAL CONTRACTOR SHALL VERIFY EXACT SIGN WIRING REQUIREMENTS WITH THE SIGN SUPPLIER PRIOR TO SUBMITTING A BID FOR THE ELECTRICAL AND INSTALL IN COMPLIANCE WITH OWNER'S AND AHJ REQUIREMENTS.
- 3 CONNECT TO J-BOX ON HOOD FOR PRE-WIRED HOOD LIGHTS.
- 4 PROVIDE SWITCH SWITCHBANK, SEE DETAIL 2, THIS SHEET.
- 5 PROVIDE 20A, 8-POLE, LIGHTING CONTACTOR (LC#1) IN NEMA 1 ENCLOSURE AND CONTROLLED BY 20A, 24-HR, 7-DAY TIME CLOCK (TORK: DZM 200A) IN NEMA 1 ENCLOSURE.
- 6 CONNECT LIGHT FIXTURE AHEAD OF AREA/ROOM SWITCH FOR "NIGHT LIGHT".
- 7 ROUTE LIGHT FIXTURE CIRCUIT THROUGH LIGHTING CONTACTOR.

ARCHITECT OF RECORD:

THOMAS E. MORGAN, JR.
ARCHITECT

423 FISCHER TRAIL
ELLIJAY, GEORGIA 30540

SEAL:

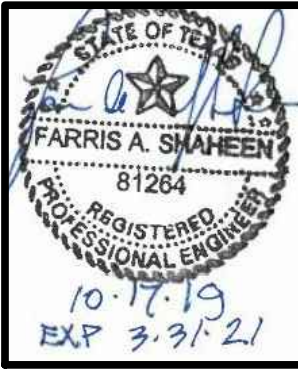

MRP
DESIGN GROUP

3450 Acworth Due West Road
Building 100, Suite 120
Kennesaw, Georgia 30144
P. 770-917-9172
F. 770-917-9470
www.mrpdesign.com

RELEASED FOR
CONSTRUCTION

ISSUES / REVISIONS:

DATE	DESCRIPTION
10/11/19	PERMIT SET

DRAWN BY: BAM

CHKD BY: FAS

PROJECT DESCRIPTION:

PROJECT DESCRIPTION

PROJECT TITLE:

**BAR-B-CUTIE
SMOKEHOUSE**
2211 EAST GRIFFIN
SUITE 100 & 110
MISSION, TX 78572

SHEET TITLE:

LIGHTING PLAN

PROJECT NO: 19044

E100

I. COORDINATE EXACT LOCATIONS OF EQUIPMENT, RECEPTACLES AND DEVICE CONNECTIONS WITH ARCHITECTURAL PLANS AND ELEVATIONS, INCLUDING NOTES, PRIOR TO ROUGH-IN.

- 1 PROVIDE 2" CP W/PU/LLWIRE FROM TELEPHONE BACKBOARD TO BUILDING MAIN TELEPHONE SERVICE POINT. COORDINATE REQUIREMENTS W/LANDLORD.
- 2 J-BOX FOR FIRE SUPPRESSION SYSTEM. PROVIDE FINAL CONNECTION FROM J-BOX TO SUPPRESSION SYSTEM. PROVIDE ALL CONDUIT AND WIRING FOR CONNECTION FROM FIRE SUPPRESSION SYSTEM TO PANEL C FEEDER BREAKER SHUNT TRIP IN PANEL MDP.
- 3 PROVIDE 2"-0'X2"-0'X3/4" PLYWOOD BACKBOARD (TBB) AND PAINT W/FIRE RETARDANT PAINT. COORDINATE PAINT COLOR WITH WALL. PROVIDE #6 GND AND CONNECT FROM TELEPHONE GROUND AND MAIN SERVICE GROUND. MOUNT BOTTOM OF BOARD AT 80" AFF.
- 4 PROVIDE CONNECTION TO W/LE MOUNTED, PREWIRED COOLER J-BOX FOR EVAPORATIVE COIL. PROVIDE CONDUIT SEALS AS REQUIRED.
- 5 HOOD CONTROL KEYPAD MOUNTED ON THE FACE OF THE HOOD. PROVIDED BY HOOD MFR. PROVIDE POWER AND INTERLOCK CONTROL WIRING FOR CONTROL AND HOOD FIRE SUPPRESSION SYSTEM. SEE HOOD FAN CONTROL INTERLOCK WIRING DIAGRAMS ON CAPTIVE-ARE DRAWINGS.
- 6 PROVIDE TV OUTLET AND RECEPTACLE AND MOUNT TO EXISTING STRUCTURE ABOVE. COORDINATE LOCATION OF OUTLETS AND RECEPTABLES WITH OWNER.
- 7 PROVIDE TV OUTLET AND RECEPTACLE AND COORDINATE LOCATION OF OUTLET AND RECEPTACLE WITH OWNER.
- 8 MOUNT RECEPTACLE ABOVE METAL ROOF FOR SIGN AND COORDINATE LOCATION OF RECEPTACLE WITH OWNER.
- 9 PROVIDE 120V, SAFETY RECEPTACLE (TAMPER-RESISTANT: HUBBELL: HBL5G-63-H1).
- 10 PROVIDE J-BOX FOR WATER HEATER CONTROLS. PROVIDE FINAL CONNECTION FROM J-BOX TO WATER HEATER.
- 11 PROVIDE RECEPTACLE FOR SMOKER EF AND VERIFY MOUNTING HEIGHT AND LOCATION.
- 12 PROVIDE 2-1" CP W/PU/LLWIRE, STUBBED-UP 6" AFF AND CAP IN BUILDING AND EXTEND CONDUIT 4'-0" OUT FROM BUILDING FOUNDATION. CAP AND MARK END OF CONDUIT FOR DRIVE-THRU MENU BOARD FOR WORK TO BE COMPLETED BY OTHERS.


NOTE 1. PROVIDE ALL CONDUIT AND WIRING REQUIRED FOR THE POWER AND CONTROL INCLUDING CONNECTION TO HOOD FIRE SUPPRESSION SYSTEM, AS SHOWN ON THE CAPTIVE-AIRE DWGS.

NOTE 2. PROVIDE 'IG' TYPE RECEPTACLE.

NOTE 3. PROVIDE ALL CONDUIT AND WIRING REQUIRED TO CONNECT HOOD KEF-1 AND MUA-1 TOGETHER FROM HOOD ELECTRICAL CONTROL PANEL, AS SHOWN ON CAPTIVE-AIRE DWGS.

NOTE 4. PROVIDE CORD AND PLUG AS NOTED IN GENERAL NOTE C.

NOTE 5. SEE DWG. E100.

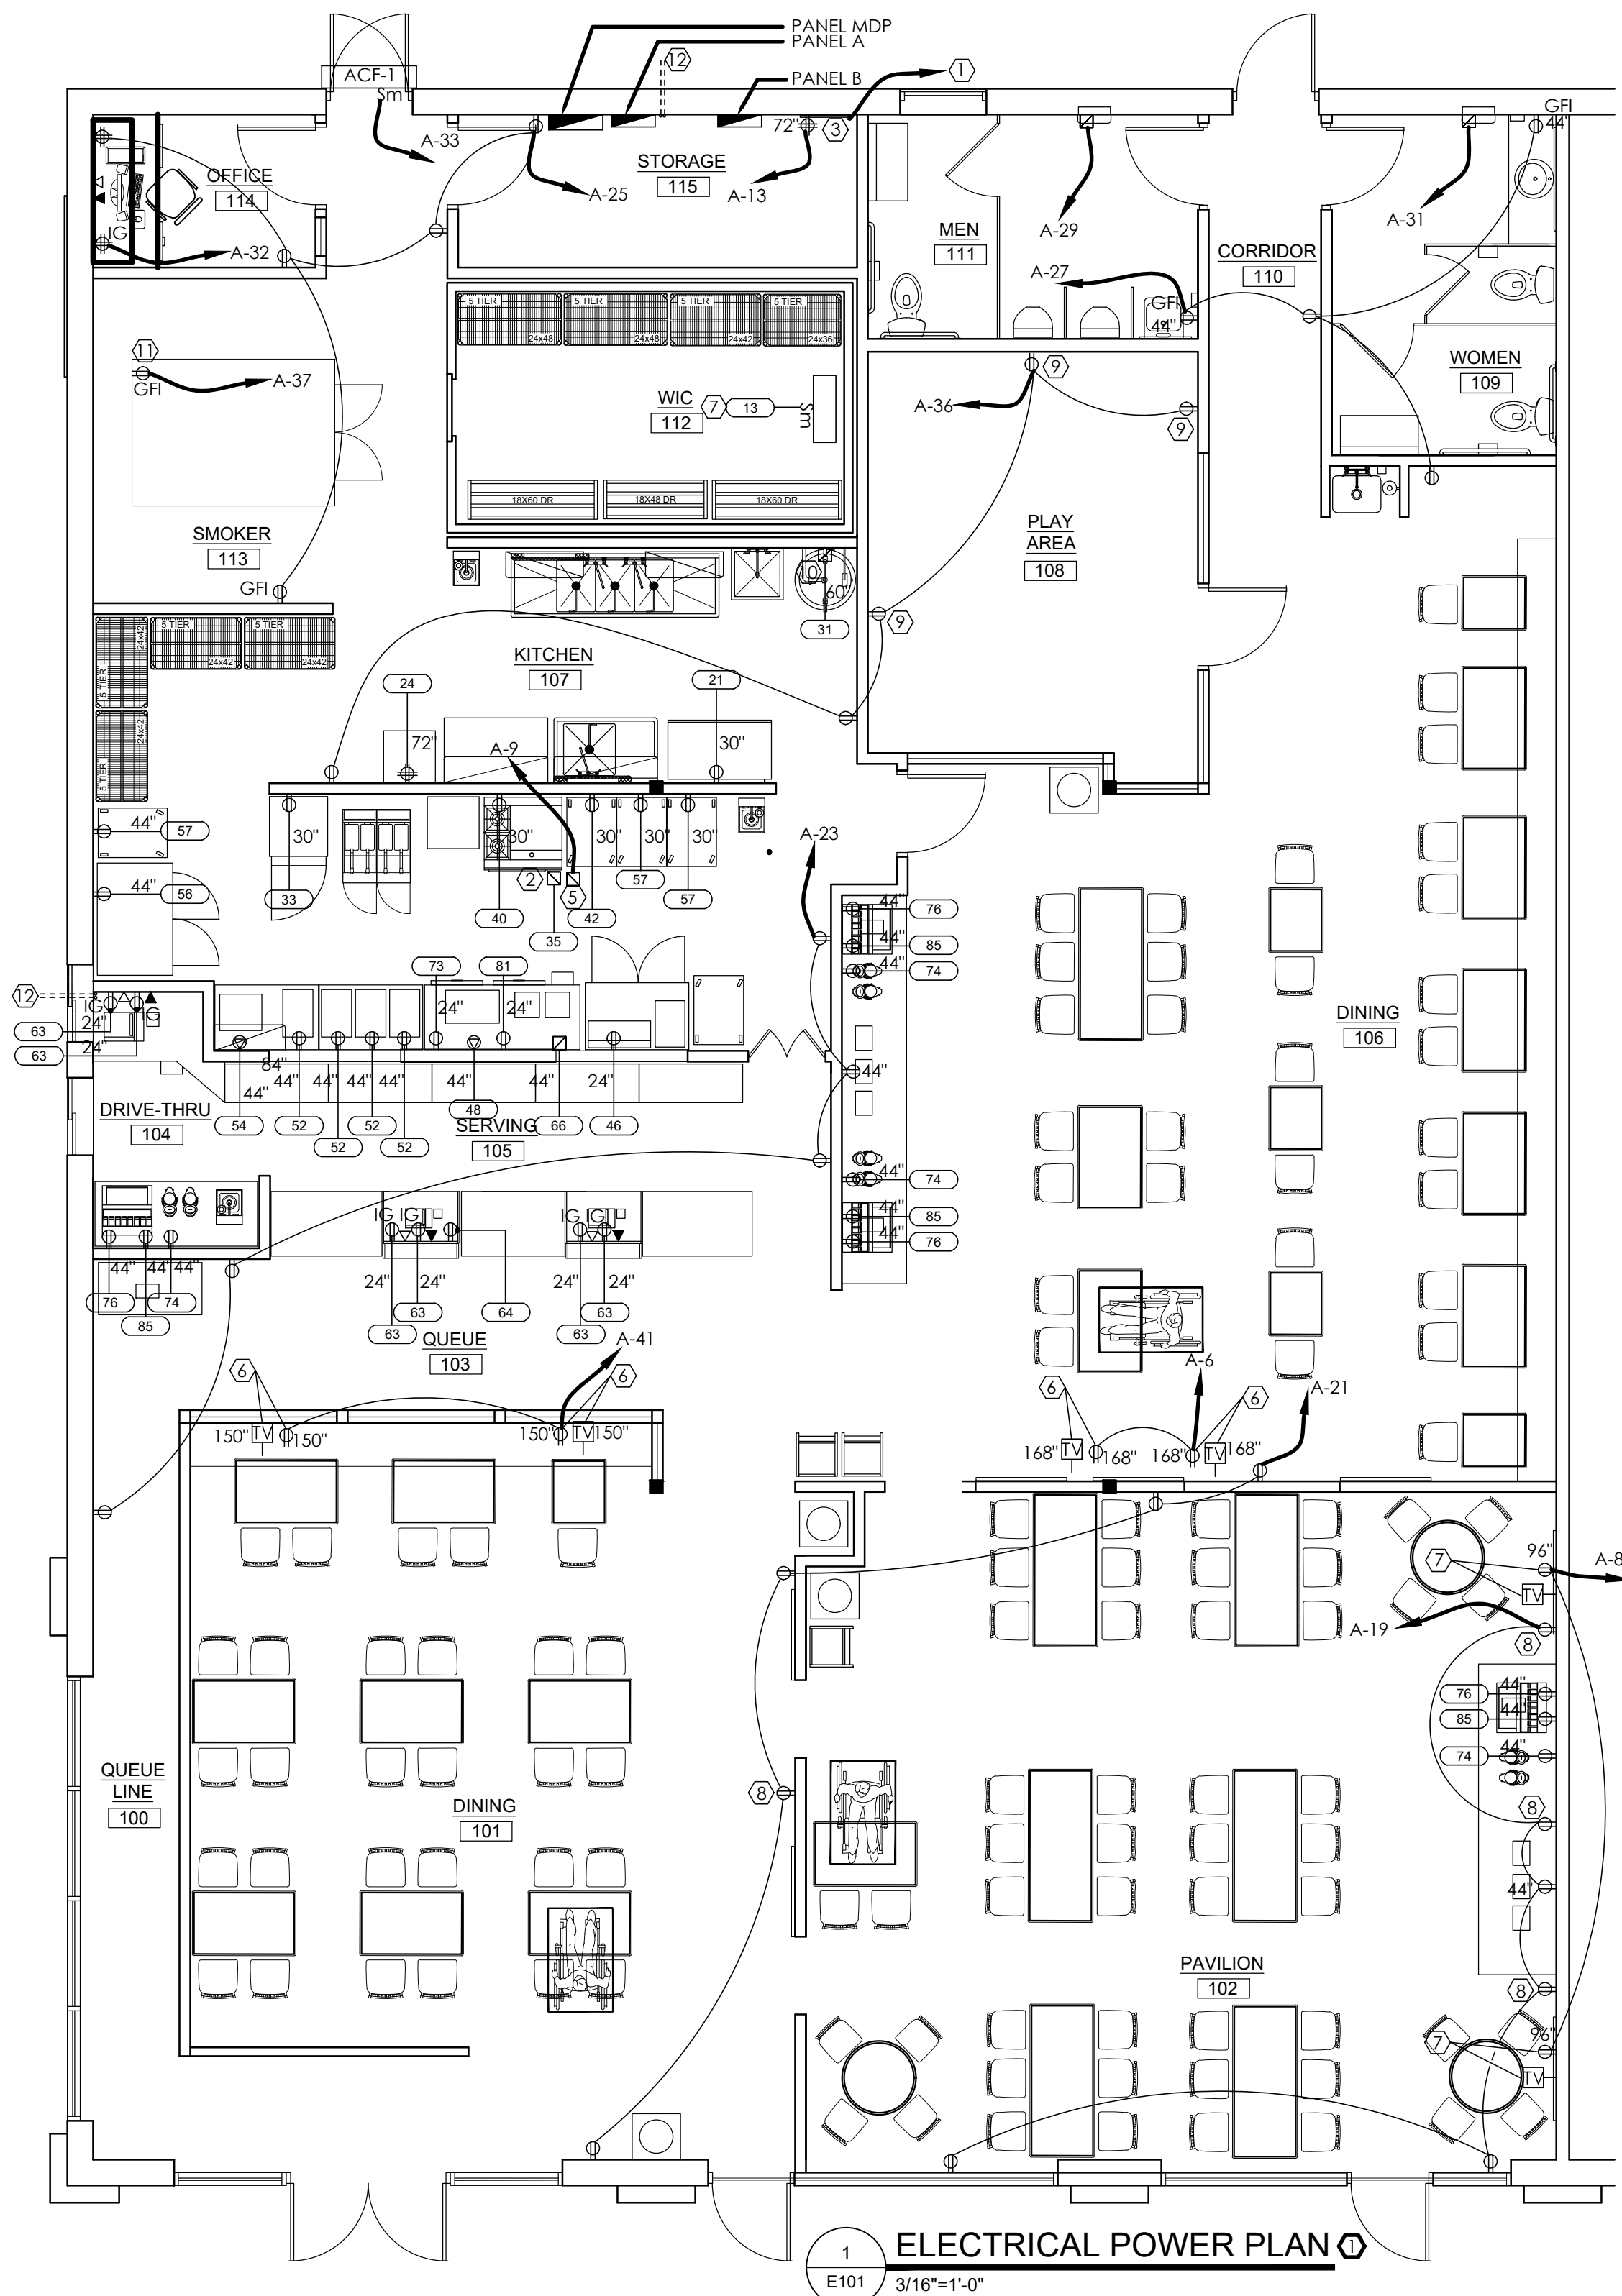

BAR-B-QUTIE'S FOOD SERVICE EQUIPMENT														
ITEM NO.	QTY	DESCRIPTION						ELECTRICAL						
			VOLTS	PHASE	KW	HP	FLA	CIRCUIT DESC	BREAKER AMPS	POLE	FEEDER	DIRECT PLUG	PLUG TYPE	NOTES
13	1	WIC LIGHTS	120	1			1.0	A-7	20	1	2#12, 2#12G-3/4"	X		5
	1	WIC EVAP COIL	120	1			1.8	B-32	20	1	2#12, 2#12G-3/4"	X		
	1	WIC CONDENSER	208	1			15.0	B-14,16	20	2	2#12, 2#12G-3/4"	X		
21	1	ICE MACHINE	120	1			11.0	B-6	20	1	2#12, 1#12G-3/4"	X	NEMA 5-20R	
24	1	BAG-N-BOX	120	1			5.0	B-2	20	1	2#12, 1#12G-3/4"	X	NEMA 5-20R	
27	1	WORKTOP FREEZER	120	1			5.8	LCA-7	20	1	2#12, 1#12G-3/4"	X	NEMA 5-20R	
31	1	WH CONTROLS	120	1			4.2	A-22	20	1	2#12, 1#12G-3/4"	X		
35	1	HOOD LIGHTS	120	1			1.8	A-11	20	1	2#12, 1#12G-3/4"	X		5
	1	HOOD CONTROLS	120	1			4.2	A-9	20	1	2#12, 1#12G-3/4"	X		
	1	HOOD, KEF-1	208	3			5.8	B-19,21,23	15	3	3#12, 1#12G-3/4"	X		3
	1	HOOD, MUA-1	208	3			4.4	B-8,10,12	15	3	3#12, 1#12G-3/4"	X		3
	1	HOOD, MUA CTL	120	1			4.2	A-15	20	1	2#12, 1#12G-3/4"	X		
	1	FIRE SUPPRESSION	120	1			4.2	A-17	20	1	2#12, 1#12G-3/4"	X		
40	1	RANGE	120	1			6.2	B-27	20	1	2#12, 1#12G-3/4"	X	NEMA 5-20R	1
42	1	HEATED CABINET	120	1			16.0	B-34	20	1	2#12, 2#12G-3/4"	X	NEMA 5-20R	
46	1	SAND, SALAD PREP REFRIG	120	1			5.8	B-31	20	1	2#12, 1#12G-3/4"	X	NEMA 5-20R	
48	1	TOASTER	208	1			12.5	B-22,24	20	2	2#12, 1#12G-3/4"	X	NEMA 6-20R	
52	4	NITRO COOKER	120	1			12.0	A-10	20	1	2#10, 2#10G-3/4"	X	NEMA 5-20R	
		NITRO COOKER	120	1			12.0	A-12	20	1	2#10, 2#10G-3/4"	X	NEMA 5-20R	
		NITRO COOKER	120	1			12.0	A-14	20	1	2#10, 2#10G-3/4"	X	NEMA 5-20R	
		NITRO COOKER	120	1			12.0	A-16	20	1	2#10, 2#10G-3/4"	X	NEMA 5-20R	
54	1	MICROWAVE	208	1			14.4	B-18,20	20	2	2#12, 2#12G-3/4"	X	NEMA 6-20R	
56	1	REACH-IN REFRIGERATOR	120	1			4.2	A-59	20	1	2#12, 2#12G-3/4"	X	NEMA 5-20R	
57	3	HEATED CABINET	120	1			16.0	B-38	20	1	2#12, 2#12G-3/4"	X	NEMA 5-20R	
		HEATED CABINET	120	1			16.0	B-40	20	1	2#12, 2#12G-3/4"	X	NEMA 5-20R	
		HEATED CABINET	120	1			16.0	B-42	20	1	2#12, 2#12G-3/4"	X	NEMA 5-20R	

[illegible]



- 3: ALL MAIN AND CROSS TEES, THEIR SPLICES AND INTERSECTING CONNECTIONS SHALL BE ADEQUATE TO RESIST 72 lb.. IN TENSION.

ARCHITECT OF RECORD

THOMAS E. MORGAN, JR.
ARCHITECT

423 FISCHER TRAIL
ELLIJAY, GEORGIA 30504

SEAL:



M R P
DESIGN GROUP
3450 Acworth Due West Road
Building 100, Suite 120
Kennesaw, Georgia 30144
P. 770-917-9172
F. 770-917-9470
www.mrpdesign.com

RELEASED FOR
CONSTRUCTION

[illegible]

DRAWN BY: CB

CHK'D BY: TM

PROJECT DESCRIPTION:

PROJECT DESCRIPTION

PROJECT TITLE: _____

BAR-B-CUTIE
SMOKEHOUSE
22211 EAST GRIFFIN
SUITE 100 & 110
MISSION, TX 78572

SHEET TITLE:

REFLECTED CEILING
FLOOR PLAN

PROJECT NO: 1904

A102

LEGEND:

- 14"Ø CORD MOUNT PENDANT
MOUNTED 66" AFF

EXHAUST FAN

12X12
CEILING DIFFUSER

H COOLER/FREEZER LIGHTS

EXIT LIGHT/ EMERGENCY

FURRING/HEADER

2'X4' FLUORESCENT LIGHT FIXTURE
IN CLG. GRID

TRACK LIGHTING

- ACT-1
2' X 4' SUSPENDED CEILING GRID

ACT-2
2' X 2' SUSPENDED CEILING GRID

FAUX ROOF FRAMING

24X24
CEILING DIFFUSER

24X24 CEILING
RETURN GRILLE


ROUND SUPPLY DIFFUSER

PROJECT NO: 1904

A405




1
A405


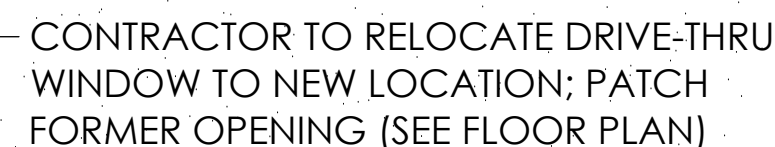


2 SIDE B
A405 1/4" = 1'-0"

M101

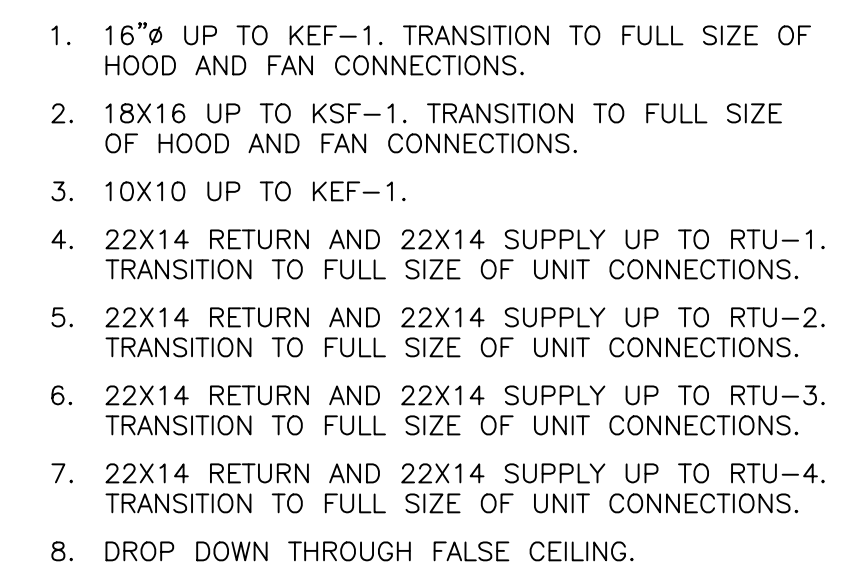
$$1/4'' = 1'-0''$$

THESE PLANS ARE THE PROPERTY OF MRP DESIGN GROUP, INC. AND ARE SUBJECT TO FEDERAL COPYRIGHT LAWS. ANY USE OF SAME WITHOUT THE EXPRESS WRITTEN PERMISSION OF MRP DESIGN GROUP, INC. IS STRICTLY PROHIBITED.

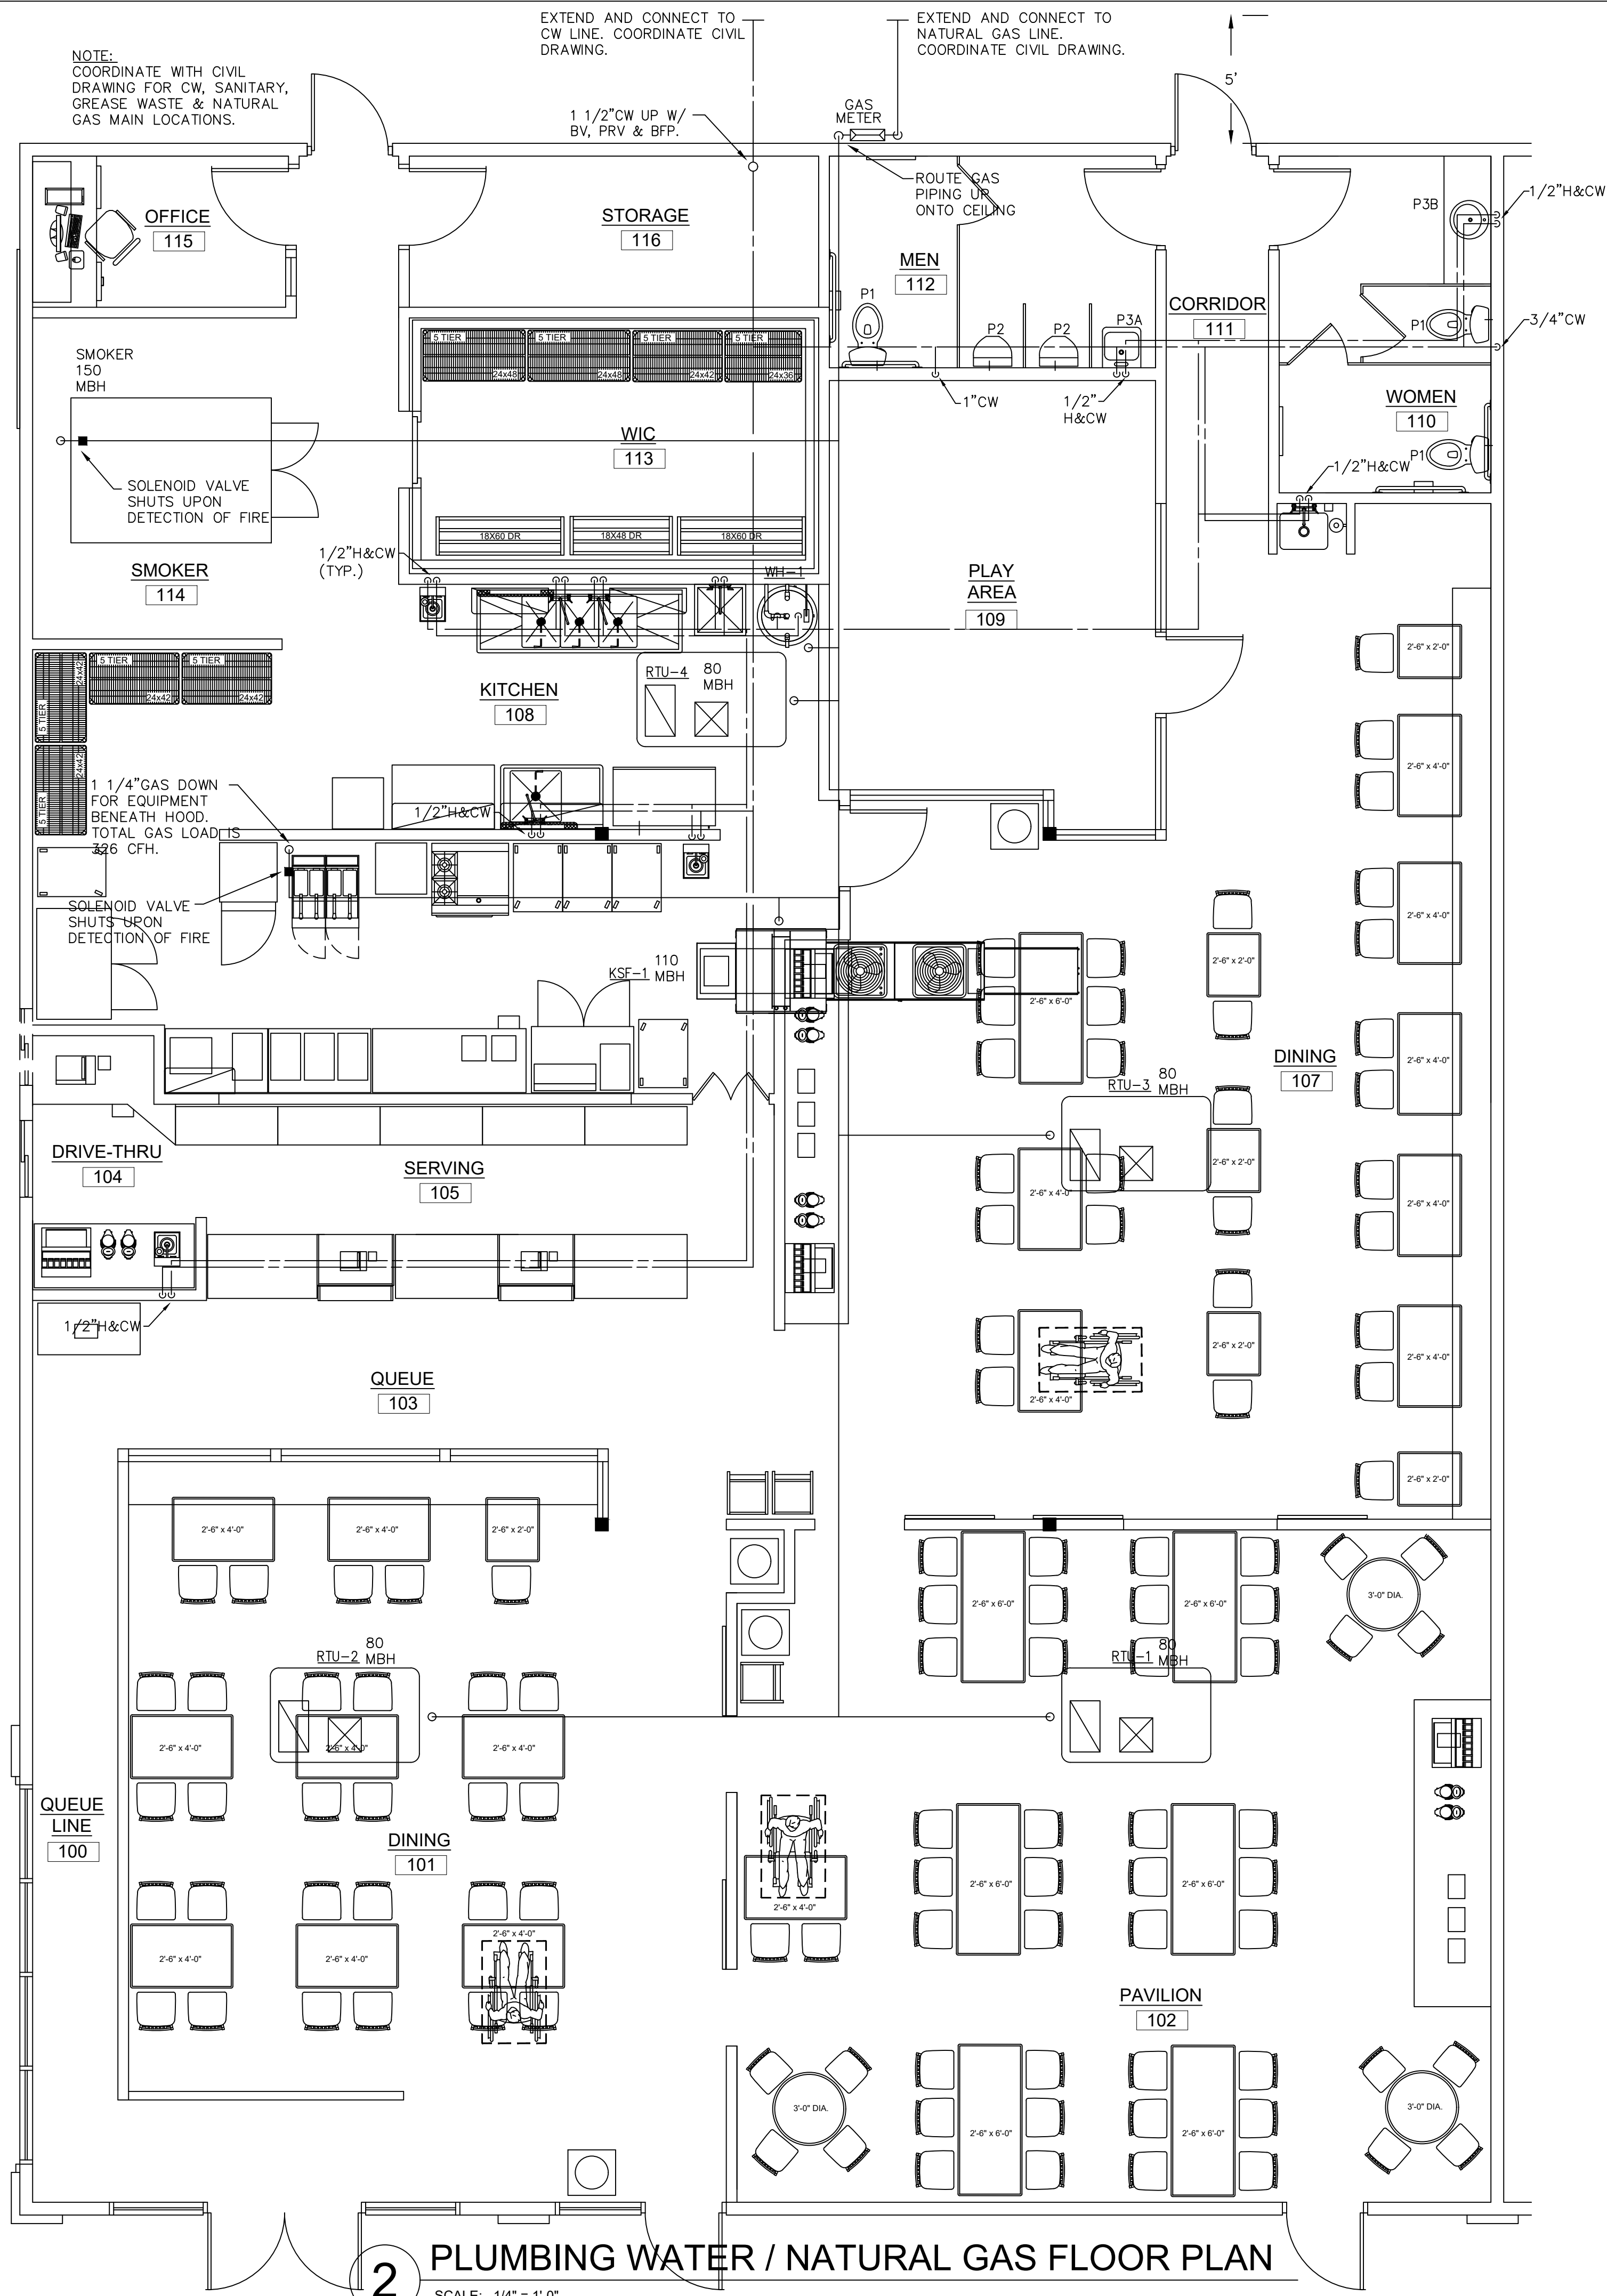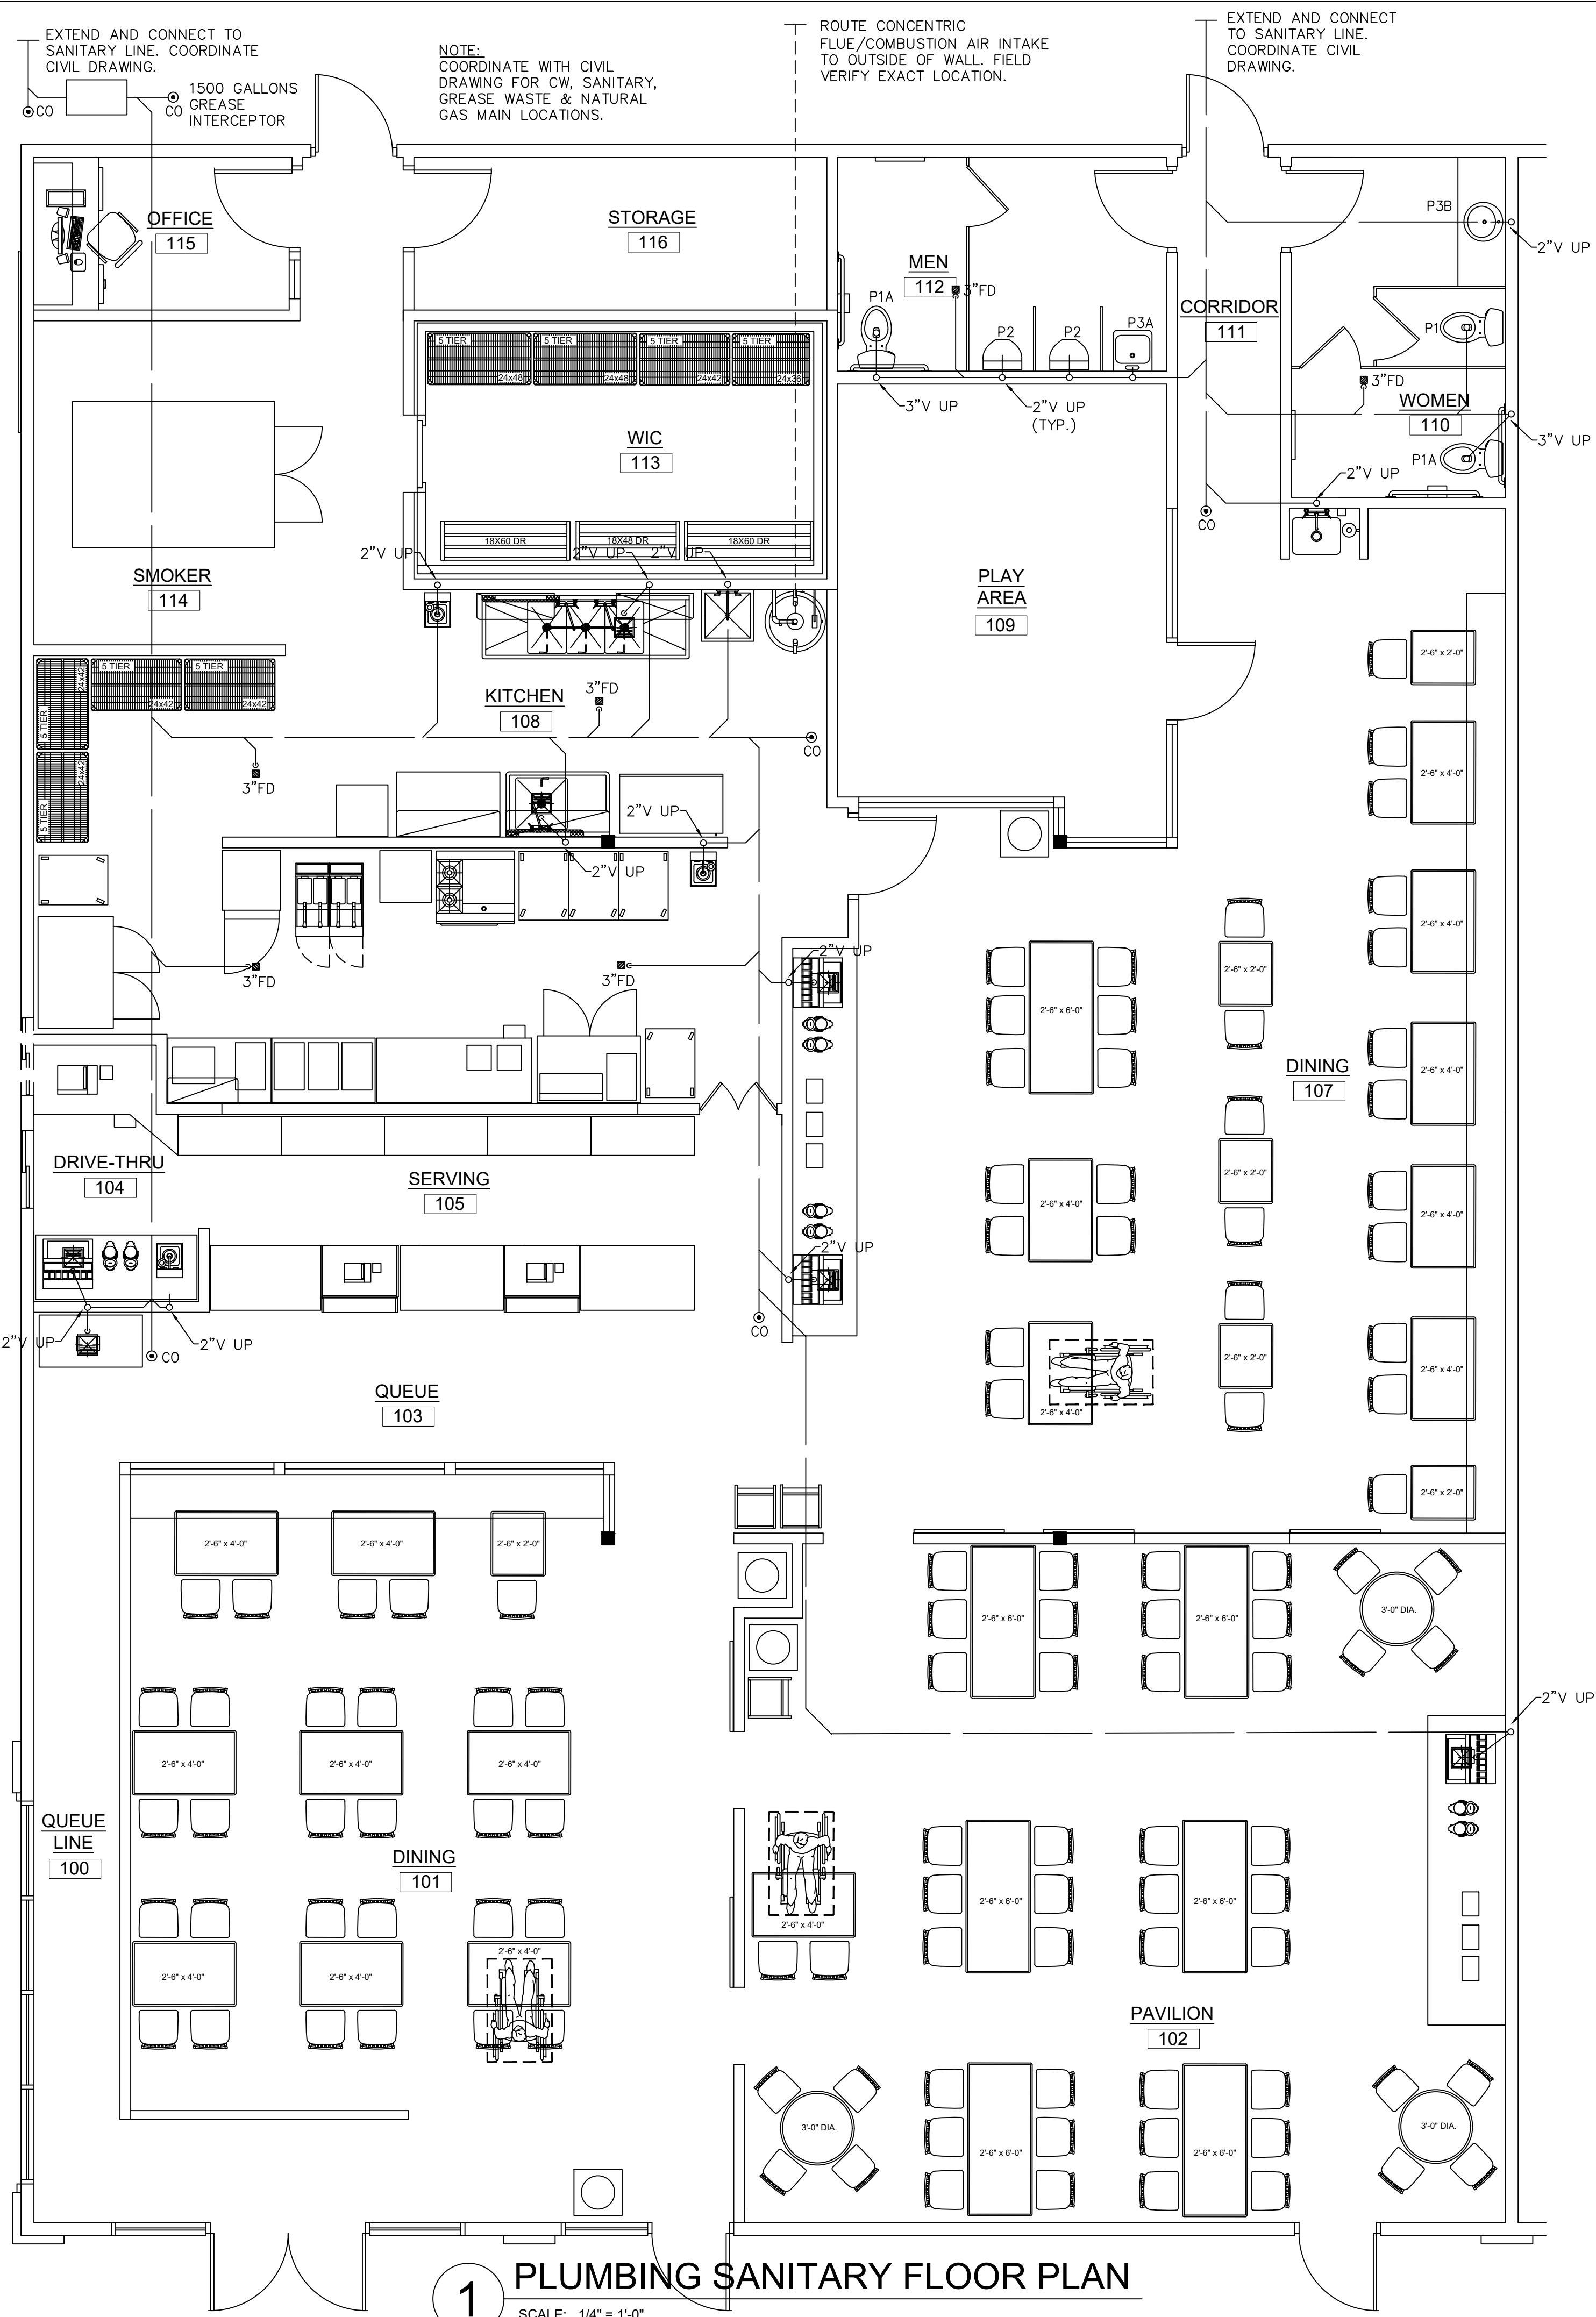

ARCHITECT OF RECORD:
THOMAS E. MORGAN, JR.
ARCHITECT
423 FISCHER TRAIL
ELLIJAY, GEORGIA 30540

SEAL:
STATE OF TEXAS
REGISTERED PROFESSIONAL ENGINEER
82903
10/11/2019

PRELIMINARY
NOT RELEASED FOR
CONSTRUCTION

ISSUES / REVISIONS:
DATE DESCRIPTION

DRAWN BY: YC
CHKD BY: BGB

PROJECT DESCRIPTION:
PROJECT DESCRIPTION

PROJECT TITLE:
BAR-B-CUTIE
SMOKEHOUSE
2211 EAST GRIFFIN
SUITE 100 & 110
MISSION, TX 78572

SHEET TITLE:
PLUMBING -
FLOOR PLAN

PROJECT NO: 19044

P101

NOTE:
TYPE OF GAS:
NATURAL GAS
MATERIAL OF GAS
PIPING: SCHEDULE 40
BLACK STEEL
SYSTEM:
SINGLE STAGE SYSTEM